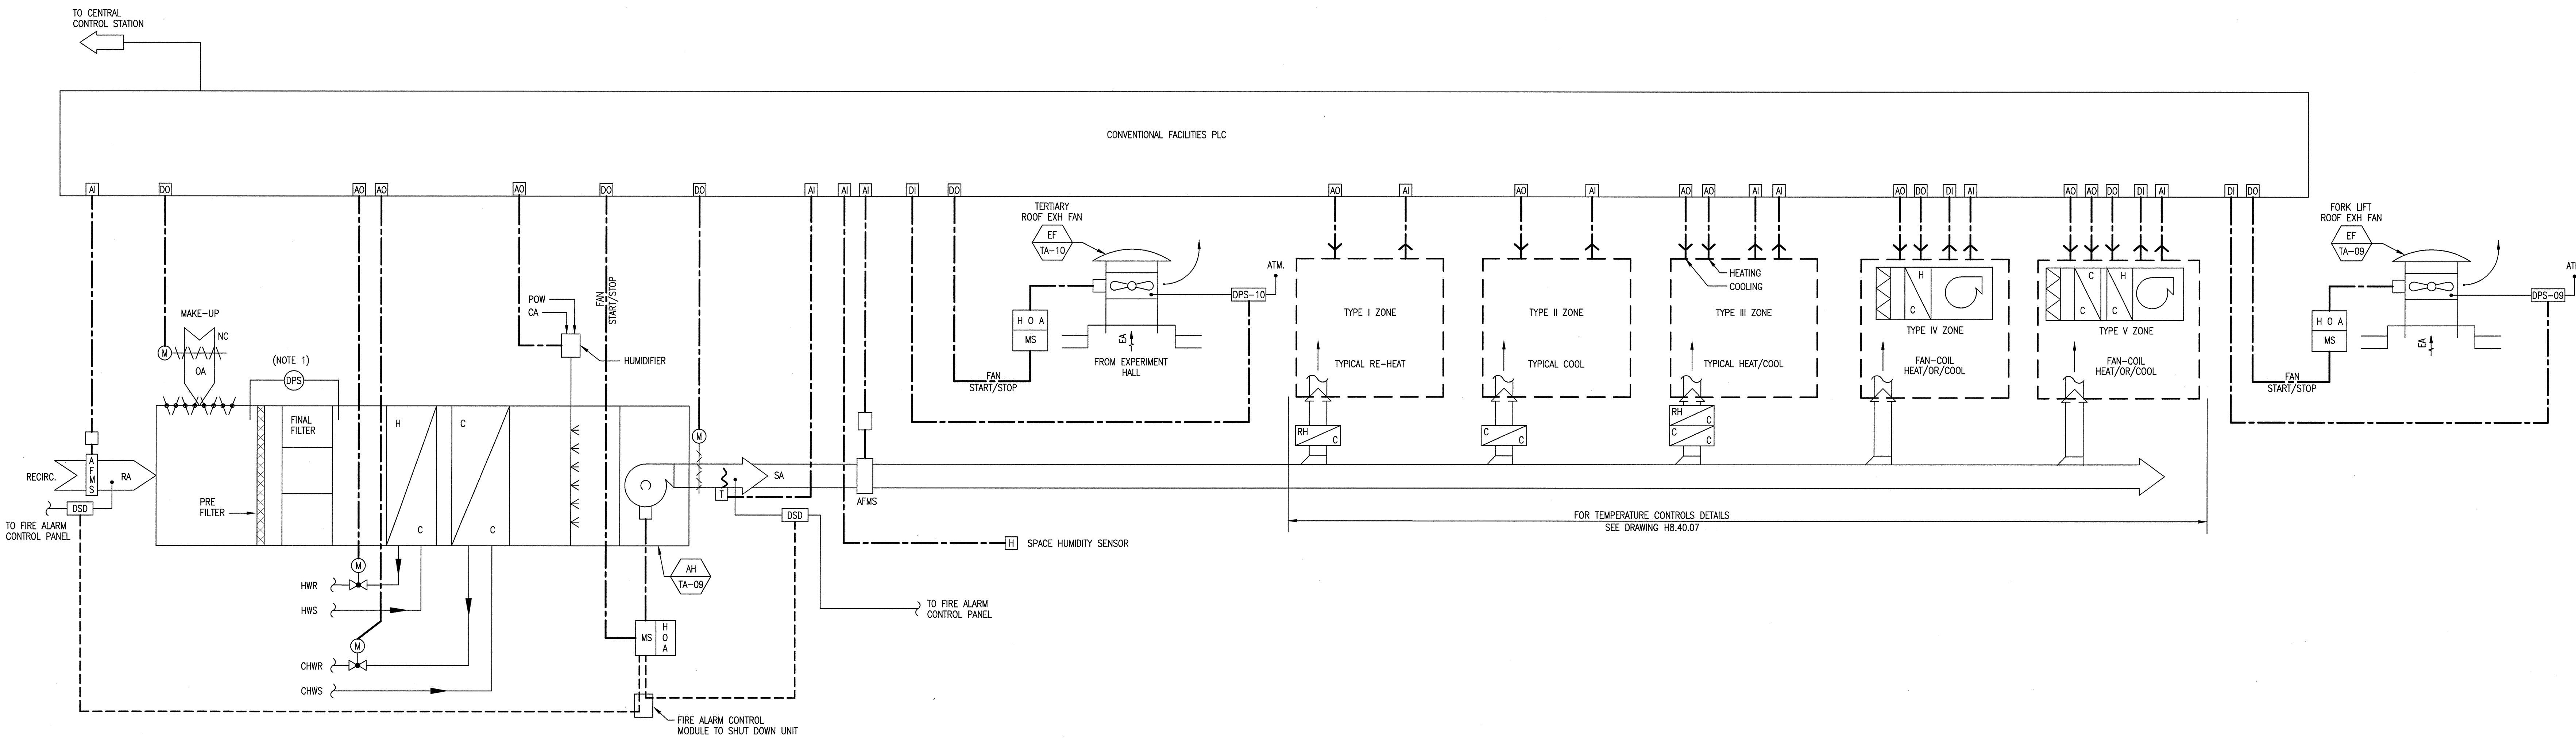

[illegible]

NOTE: DUE TO SPACE RESTRICTIONS THE AFMS WAS LOCATED IN THE RETURN DUCT TO AH-TA-09. OUTSIDE AIR SHALL BE MEASURED BY SUBTRACTING THE RETURN AIR FROM THE SUPPLY AIR.




NOTES:

1. FURNISHED WITH AIR HANDLING UNIT EQUIPMENT.

BASEMENT LEVEL AIR HANDLER AH-TA-09 CONTROL DIAGRAM

[illegible]

FOR REFERENCE ONLY	RPE	DSN M.KDHOE	11/13/01	<div><div>Oak Ridge National Laboratory managed for the DEPARTMENT OF ENERGY under U.S. GOVERNMENT contract DE-AC05-00OR22725 UT-BATTLE, LLC, c/o Oak Ridge, Tennessee</div></div>													
	DRW	J.STEIN	11/13/01														
	CHK	B.JOHNSON	11/13/01														
				PROJECT NAME:													
				SPALLATION NEUTRON SOURCE													
				TARGET BUILDING													
			BASEMENT AHU CONTROL DIAGRAM														
				1	3	48	49	50	PLANT	8	BLDG	FL	SH.	1	OF	TYPE	CLASS
				51	52	53	WBS										
				NC	NA		1.8.3.7										REV A
REV.	DATE	UTB															
DRAWING APPROVALS																	